

FRESH AIR DAMPER REPLACEMENT MOTOR ASSEMBLY

MODELS: FAD 4-10 RPLC MOTOR ASSY



NOTE: THE FAD MOTOR ASSEMBLY IS OPERATED BY 24 VAC ONLY.

NOTE: DO NOT TURN DAMPER MANUALLY OR MOTOR DAMAGE WILL OCCUR.

READ THESE INSTRUCTIONS CAREFULLY AND COMPLETELY BEFORE PROCEEDING WITH THE INSTALLATION

This device **MUST** be installed by a qualified agency in accordance with the manufacturer's installation instructions. The definition of a qualified agency is: any individual, firm, corporation or company which either in person or through a representative is engaged in, and is responsible for, the installation and operation of HVAC appliances, who is experienced in such work, familiar with all the precautions required, and has complied with all the requirements of the authority having jurisdiction.

Please retain these instructions after installation.

Installed By: _____ Phone: _____ Installation Date: _____

INSTALLATION INSTRUCTIONS



FIELD CONTROLS
Improving Indoor Environments

REMOVAL AND INSTALLATION

1. Remove the FAD replacement motor assembly from the packaging and examine for possible shipping damage.
2. Verifying proper alignment of the wiring harness connectors on the existing motor assembly disconnect the wiring harness connector and strain relief connector from the motor assembly.
3. Carefully inspect the wiring harness connectors for looseness, corrosion, or other damage to the terminals.
4. Verify that the damper wiring harness is properly connected to the controller.
5. Remove the two screws that attach the motor assembly to the damper bracket, and remove the motor assembly from the damper. (See Figure 1)
6. Rotate the damper shaft counterclockwise through at least one full revolution, to verify freedom of motion. **DO NOT ROTATE THE DAMPER SHAFT IN THE CLOCKWISE DIRECTION; DAMAGE TO THE DAMPER MAY OCCUR.** Some resistance should be felt when the damper rotates through the closed position.
7. Mark the damper size on the unit label with a permanent marker. Example: "Model #: FAD-4".
8. Record the following information on the cover label:
INSTALLER:
ADDRESS:
DATE INSTALLED:
9. Install the replacement motor assembly on the damper, using caution to avoid rotating the damper shaft in the clockwise direction. **DO NOT ATTEMPT TO ROTATE THE MOTOR ASSEMBLY SHAFT COUPLING BY HAND; DAMAGE TO THE MOTOR WILL OCCUR!**
10. Replace and firmly tighten the two attaching screws.
11. Align the wiring harness connector as shown on the motor assembly cover, and connect the wiring harness to the replacement motor assembly. **DO NOT FORCE THE CONNECTION; A MISMATCH MAY CAUSE A HAZARDOUS CONNECTION!**
12. Reconnect and tighten the harness strain relief to the conduit bracket. (See Figure 1)

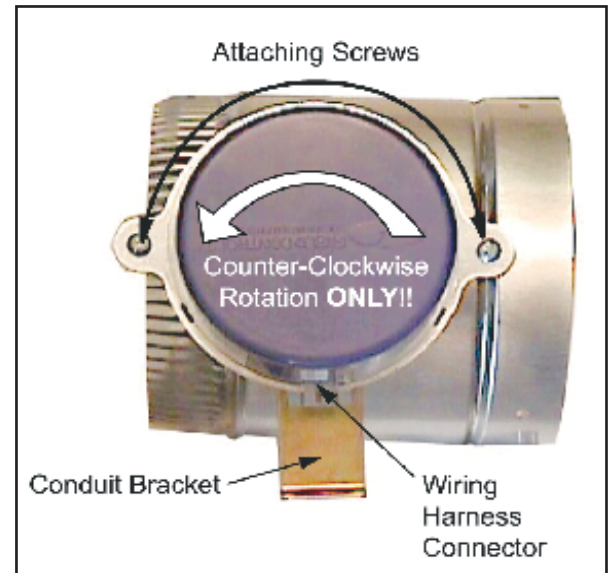


FIGURE 1



FIGURE 2

CHECKOUT PROCEDURE

1. Verify that the service switch on the replacement motor assembly is in the "Automatic" position, as denoted on the motor cover. (See Figure 2)
2. Set the controller to call for the damper to open. Verify the damper opens, as seen in Figure 3.
3. Set the controller to call for the damper to close. Verify the damper closes, as seen in Figure 4.
4. Set the controller back to normal operation.



FIGURE 3



FIGURE 4

This manual may be downloaded and printed from the Field Controls website (www.fieldcontrols.com)

WARRANTY

For warranty information about this or any Field Controls product, visit:
www.fieldcontrols.com/warranty



FIELD CONTROLS
Improving Indoor Environments